


**SECTION B-B**

(NOT TO SCALE)

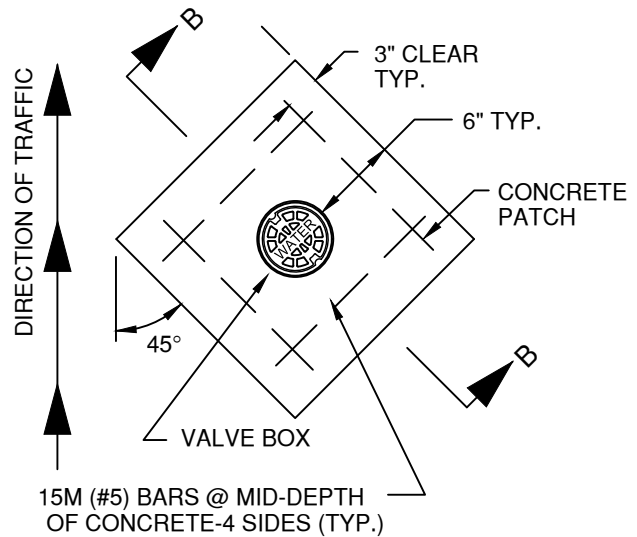

**PLAN VIEW**

**NOTES:**

1. SUBGRADE SHALL BE COMPACTED AS PER SPECIFICATIONS.
2. VALVE CASTINGS SHALL BE ADJUSTED TO GRADE AFTER FINAL LIFT OR FINAL GRADE IS IN PLACE.
3. CLEAN VALVE BOX OF ALL DEBRIS DOWN TO THE BASE OF THE VALVE.
4. EXISTING RISER PIPE SHALL BE REPLACED WITH DUCTILE IRON ELEVATION USING NEW PIPE AND A COLLAR CASTING.
5. REINFORCING STEEL SHALL MEET SPECIFICATIONS.
6. VALVES WILL BE ACCOMPANIED BY A "V" ETCHED INTO CURB FACE PAINTED BLUE



**CITY OF SCHERTZ TEXAS**  
ENGINEERING AND PUBLIC WORKS

**VALVE BOX**

STANDARD DETAIL  
N.T.S.

PW SPECIFICATION SECTION 02085

SHEETNUMBER	PROJECT NO.:	DATE: 2/26/18
DRWN. BY: BCP	DSGN. BY: BCP	CHKD. BY: KJW
		SHEET NO.: XX