

**CITY OF SCHERTZ, TEXAS  
WATERLINE RELOCATION: FM 1518 AND WOMAN HOLLERING CREEK  
PROJECT NO. 1124.8410**

**ADDENDUM NO. 1**

**Date of Addendum: September 6, 2012**

**TO: Prospective Bidders**

Be advised that this Addendum No.1 affects the following changes in the Contract Documents:

**CONTRACT DOCUMENTS**

**INVITATION TO BIDDERS:**

No change.

**INSTRUCTIONS TO BIDDERS:**

Change “one original and two copies” to “one original and four copies”.

**TECHNICAL SPECIFICATIONS:**

Section 01110 “Summary of Work”, replace 1.02.A.1 with the following:

1. All work within the TxDOT right of way will be performed in accordance to the TxDOT permit.

**PLANS:**

Sheets 4-6: The requirement for flowable fill as secondary backfill has been removed from the plans.

Sheet 3 of 8: Clarification on TPDES requirements, see attached pages 1A and 1B.

**Acknowledgement by Bidder**


Each bidder is requested to acknowledge receipt of this Addendum No.1 by his/her signature affixed hereto and to file it with and attached to his/her bid.

The undersigned acknowledges receipt of this Addendum No. 1, and that the bid submitted herewith is in accordance with the information and stipulations set forth.

\_\_\_\_\_  
Date

\_\_\_\_\_  
Signature of Bidder

\_\_\_\_\_  
Typed or Printed Name

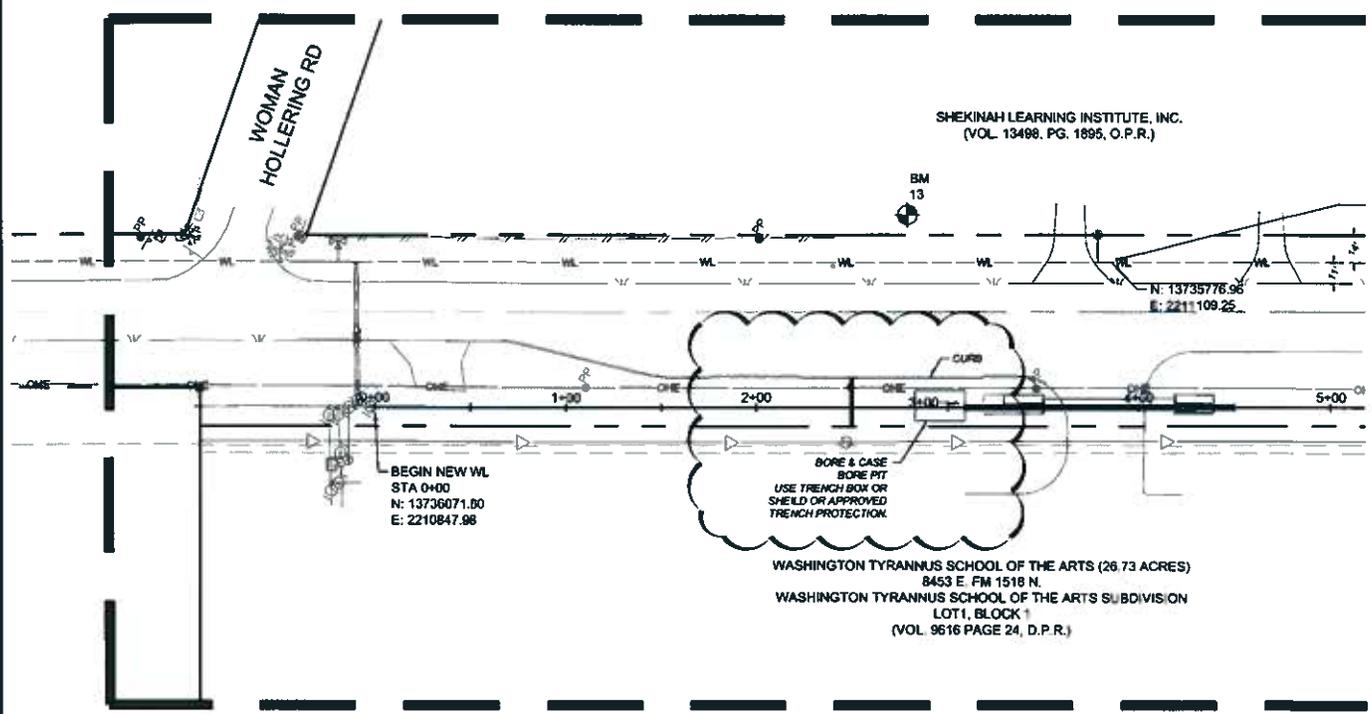

- THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PREPARATION AND IMPLEMENTATION OF THE STORMWATER POLLUTION PREVENTION PLAN, INCLUDING COMPLYING WITH ALL APPLICABLE REGULATIONS RELATED TO NPDES & TPDES, AND SUBMITTING REQUIRED NOTIFICATION OF INTENT AND TERMINATION. THIS IS TO BE PAID FOR UNDER "STORM WATER POLLUTION PREVENTION PLAN" ITEM.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE SITE CONDITIONS DURING CONSTRUCTION AND UNTIL THE PROJECT IS ACCEPTED. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING THE STORM WATER POLLUTION PREVENTION PLAN, UNDERSTAND THE REQUIREMENTS FOR THE PLAN, AND SHALL BE RESPONSIBLE FOR IMPLEMENTING THE PLAN. THIS IS TO BE INCLUDED UNDER SECTION 01410 "STORM WATER POLLUTION PREVENTION PLAN". ALL FINES IMPOSED FOR NOT IMPLEMENTING OR MAINTAINING SWPPP MEASURES SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR.
- PLACE SILT FENCE EVERY 300 FT FOR WIDTH OF DISTURBED AREA, AT A MINIMUM.
- DISTURBED AREAS TO BE REVEGETATED WITH BERMUDA SOD OR NATIVE GRASS AS PART OF SITE RESTORATION ITEM.
- BORE PITS TO BE RESTORED PER SCHERTZ STANDARD SPEC 02317 "EXCAVATION AND BACKFILL FOR UTILITIES", MINIMUM COMPACTION OF 90% ASTM D 698.

TEMPORARY EROSION CONTROL LEGEND	
	TEMPORARY TYPE I ROCK FILTER DAM TYPE 2, TXDOT DETAIL EC (2) - 93
	TEMPORARY SEDIMENT CONTROL FENCE, TXDOT DETAIL EC (1) - 93

**CONTROL COORDINATES:**

#	NORTHING	EASTING	ELEVATION	DESCRIPTION
2	13735392.3800	2211332.2230	671.004	SET IRON ROD WITH FORD TRAVERSE CAP
13	13735827.3820	2211090.7680	675.354	SET IRON ROD WITH FORD TRAVERSE CAP


\*ALL COORDINATES PROVIDED ARE IN MODIFIED STATE PLANE, SOUTH CENTRAL TEXAS, WITH A SCALE FACTOR OF 1.00014



**FORD ENGINEERING INC.**  
ENGINEERING • SURVEYING • PLANNING  
10927 WYE DRIVE, SUITE 104, SAN ANTONIO, TEXAS 78217  
PHONE: (210) 590-4777 FACSIMILE: (210) 590-4940  
www.fordengineering.com TBPE No. F-1162

**SHEET 3 OF 8 - ADDENDUM 1**  
**WATER LINE RELOCATE**  
**FM 1518 AT WOMAN HOLLERING CREEK**  
**OVERALL PROJECT LAYOUT**

SCALE: 1" = 100'  
DATE: 9-5-2012  
PROJECT NO 1124.8410  
**1A**

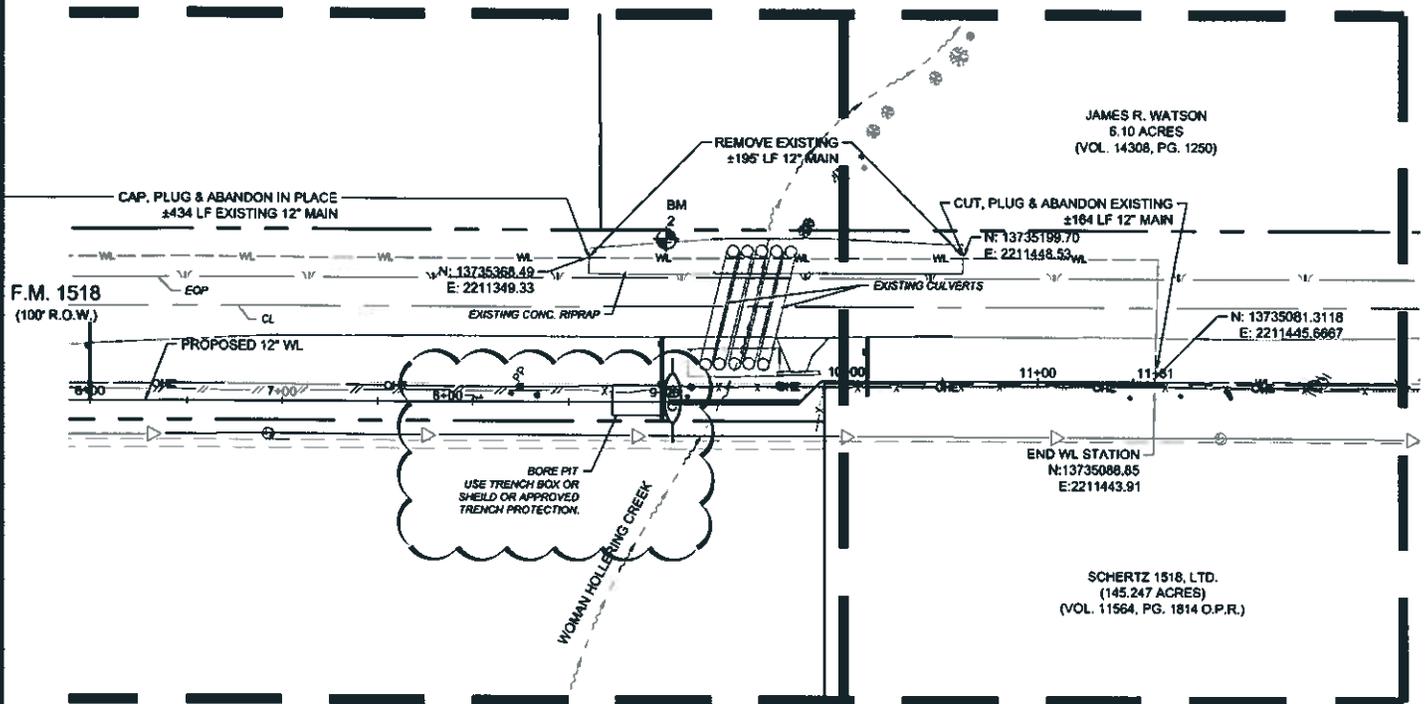

**SWPPP GENERAL NOTES:**

1. THE CONTROL MEASURES CONTAINED HEREON (AND AS FURTHER DESCRIBED BY THE STANDARD SPECIFICATIONS) SHALL BE INSTALLED AND MAINTAINED THROUGHOUT THE CONSTRUCTION CONTRACT TO ASSURE EFFECTIVE AND CONTINUOUS WATER POLLUTION CONTROL DURING CONSTRUCTION AND POST CONSTRUCTION PERIODS. (SEE STANDARD SPEC. ITEM 01410)
2. A RAIN GAUGE SHALL BE PROVIDED BY THE CONTRACTOR AND LOCATED AT THE PROJECT SITE. WITHIN 24 HOURS OF A RAINFALL EVENT OF 0.5 INCHES OR MORE (AS MEASURED BY THE PROJECT SITE GAUGE) THE CONTRACTOR AND INSPECTOR WILL INSPECT THE ENTIRE PROJECT TO DETERMINE THE CONDITION OF THE CONTROL MEASURES. SEDIMENT WILL BE REMOVED AND DEVICES REPAIRED AS SOON AS PRACTICABLE BUT NO LATER THAN 7 DAYS AFTER THE SURROUNDING EXPOSED GROUND HAS DRIED SUFFICIENTLY TO PREVENT FURTHER DAMAGE BEING CAUSED BY REPAIR OPERATIONS. (SEE STANDARD SPEC. ITEM 01410)
3. THE CONTRACTOR SHALL CLEAN PAVED SURFACES (ADJACENT TO THE CONSTRUCTION AREAS) AS NECESSARY TO REMOVE SEDIMENT WHICH HAS ACCUMULATED ON THE ROADWAY DUE TO STORM WATER FLOWS AND VEHICULAR TRAFFIC THROUGH AND ACROSS THE CONSTRUCTION SITE. (SEE STANDARD SPEC. ITEM 01410)
4. IN CASE OF FAILURE ON THE PART OF THE CONTRACTOR TO PREVENT AND CONTROL SOIL EROSION, SEDIMENTATION AND WATER POLLUTION WHICH MAY DEGRADE RECEIVING WATERS, THE ENGINEER RESERVES THE RIGHT TO EMPLOY OUTSIDE ASSISTANCE OR USE CITY FORCES TO PROVIDE THE NECESSARY CORRECTIVE MEASURES. ALL COSTS (INCLUDING ENGINEERING COSTS) WILL BE DEDUCTED FROM ANY MONEYS DUE TO OR TO BECOME DUE TO THE CONTRACTOR. (SEE STANDARD SPEC. ITEM 01410)
5. UPON COMPLETION OF CONSTRUCTION AND THE INSTALLATION OF PERMANENT EROSION CONTROL METHODS, A FINAL EROSION CONTROL INSPECTION WILL BE PERFORMED AS PART OF ACCEPTANCE OF THE PROJECT BY THE CITY. IN THE EVENT THAT THE PERMANENT EROSION CONTROL IS INADEQUATE DUE TO IMPROPER DESIGN OR INSTALLATION, THE PERMANENT EROSION CONTROL MEASURE MUST BE CORRECTED OR REDESIGNED TO FUNCTION PROPERLY. (SEE STANDARD SPEC. ITEM 01410)
6. CONTRACTOR TO PREPARE A STORM WATER POLLUTION PREVENTION PLAN PER PERMIT TXR 15000 FOR A "SMALL CONSTRUCTION ACTIVITY". UPDATE OR REVISE THE SWP3 AS NEEDED DURING THE CONSTRUCTION FOLLOWING PART III, SECTION E OF THE CONSTRUCTION GENERAL PERMIT. SUBMIT THE SWP3 AND ANY UPDATES OR REVISIONS TO PUBLIC WORKS FOR REVIEW AND ADDRESS COMMENTS PRIOR TO COMMENCING, OR CONTINUING, CONSTRUCTION ACTIVITIES.

**GENERAL NOTES FOR TEMPORARY EROSION METHODS**

1. SOILS EXCAVATED FROM THE SITE ARE TO BE REMOVED FROM SITE IMMEDIATELY. IF TEMPORARY STOCKPILES ARE PLACED DURING CONSTRUCTION THEY SHALL BE ENCLOSED BY A TEMPORARY SEDIMENT CONTROL FENCE AT THE CONTRACTOR'S EXPENSE
2. ALL AREAS DISTURBED BY CONSTRUCTION SHALL BE RE-VEGETATED AFTER CONSTRUCTION IS COMPLETE. CONTRACTOR SHALL BE RESPONSIBLE FOR ESTABLISHING VEGETATION IN ALL DISTURBED AREAS BY WATERING OR OTHER ACCEPTABLE MEANS.
3. FILTER BAGS SHOULD BE ADDED TO AREA INLETS WITHIN THE SITE AFTER INSTALLATION
4. ALL TEMPORARY STORM WATER POLLUTION PREVENTION AND TEMPORARY EROSION CONTROL MEASURES TO BE PAID FOR UNDER PAY ITEM FOR "STORM WATER POLLUTION PREVENTION".

**THIS PLAN IS PROVIDED AS AN AIDE TO THE CONTRACTOR IN PREPARING THE SWPPP, AND DOES NOT REMOVE THE RESPONSIBILITY FROM THE CONTRACTOR.**



**FORD ENGINEERING INC.**  
ENGINEERING • SURVEYING • PLANNING  
10927 WYE DRIVE, SUITE 104, SAN ANTONIO, TEXAS 78217  
PHONE: (210) 590-4777 FACSIMILE: (210) 590-4940  
www.fordengineering.com TBPE No. F-1162

SHEET 3 OF 8 - ADDENDUM 1  
WATER LINE RELOCATE  
FM 1518 AT WOMAN HOLLERING CREEK  
OVERALL PROJECT LAYOUT

SCALE: 1" = 100'  
DATE: 9-5-2012  
PROJECT NO. 1124.8410

**1B**